


USER Manual (v1.3)

Chapter 1

FI110 is a multifunctional and practical industrial fan controller developed by our company. It has the characteristics of high protection, easy control, and stable operation. It supports rapid power on and off, and can also choose functions such as fast switching of forward and reverse rotation of the motor.


Chapter 2 product information

2.1 Designation rules


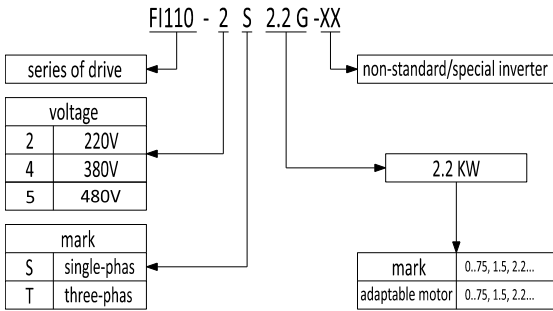


Note: The suffix area of the model number only displays the configuration with optional options, and no suffix is required for standard configuration.


2.2 Nameplate of the FI110

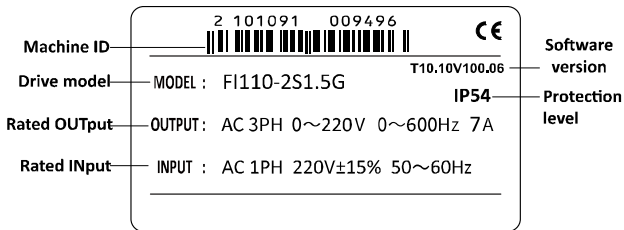

2.3 Description for power switch & forward/reverse switch

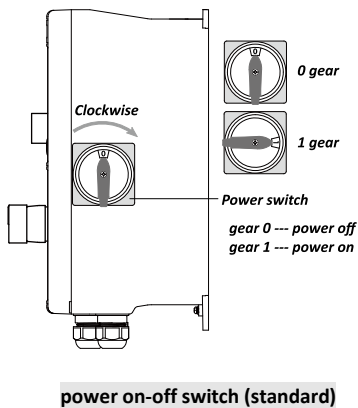

2.4 Operation panel

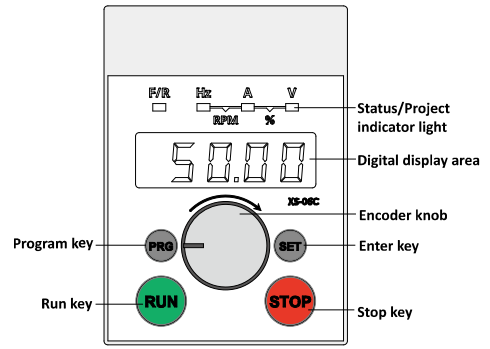

keyboard with encoder


Introduction to keyboard key functions

	Program key	<ul style="list-style-type: none"> Level 1 menu entry or exit, programming mode switch
	Enter key	<ul style="list-style-type: none"> Enter the menu screen step by step, confirm and save the parameters
	Run key	<ul style="list-style-type: none"> In the keyboard operation mode, start the inverter
	Stop key	<ul style="list-style-type: none"> In the keyboard operation mode, stop the inverter, Press this key to reset the inverter after the fault occurs and the fault is rectified.
	Encoder knob	<ul style="list-style-type: none"> Left-handed value decreases/right-handed value increases, Move one character (or digit) to the right with each press

Chapter 3 Product installation


3.1 Product Size

(Unit : mm)

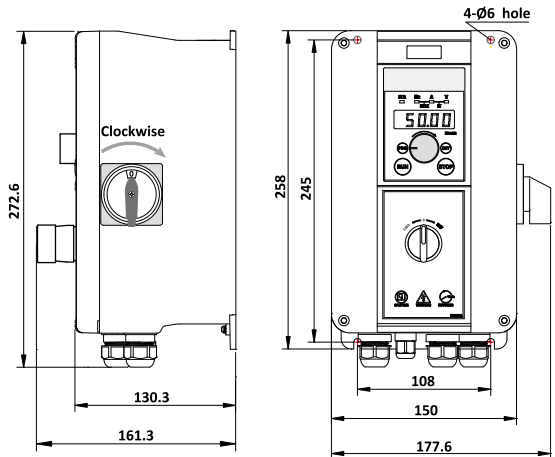

3.2 Main circuit terminal wiring

3.2.1 Single-phase power supply/three-phase power supply wiring (standard with power on-off switch)

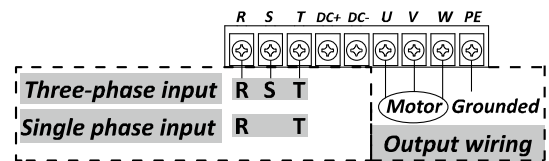

Three-phase & single-phase AC power wiring diagram

Application model:

Single phase: FI110-2S(0.75 ~ 2.2)G

Three-phase: FI110-2T(0.75 ~ 2.2)G FI110-4T(0.75 ~ 4.0)G

Single-phase wiring:

Terminal marking	name	explain
R T	Single-phase AC power input terminal	Connecting to single-phase AC power
U V W	Inverter output terminal	Connecting a three-phase motor
PE	Ground terminal	Inverter ground terminal

Three-phase wiring:

Terminal marking	name	explain
R S T	three-phase AC power input terminal	Connecting to three-phase AC power
U V W	Inverter output terminal	Connecting a three-phase motor
PE	Ground terminal	Inverter ground terminal

Chapter 4 Debugging steps and parameters

Step number	Function code	Set value	Function Description
1	P0.13	1	restore factory defaults
2	P0.04	determined by the motor	Enter the rated frequency of the motor
3	P0.05		Enter the upper limit frequency or maximum speed of the motor demand operation
4	P0.10	0	If the motor is in the reverse direction, it can be set to 1 to achieve the purpose of changing the direction of the motor without changing the motor wiring.
5	P0.11	12.0kHz	The carrier frequency above 3Hz (if the electromagnetic noise of the motor is large, it can be increased, generally around 12K)
6	P2.03	determined by the motor	Enter the rated frequency of the motor
7	P2.04		Enter the rated speed of the motor
8	P2.06		Input motor rated current

Chapter 5 Fault diagnosis and treatment method

Fault code description and countermeasures

Code	Display	Possible Causes	Solutions
E001	Overcurrent during acceleration	1: The output circuit is grounded or short circuited. 2: Motor auto-tuning is not performed. 3: The acceleration time is too short. 4: Manual torque boost or V/F curve is not appropriate. 5: The voltage is too low. 6: The startup operation is performed on the rotating motor. 7: A sudden load is added during acceleration. 8: The AC drive model is too small power class.	1: Eliminate external faults. 2: Perform the motor auto-tuning. 3: Increase the acceleration time. 4: Adjust the manual torque boost or V/F curve. 5: Adjust the voltage to normal range. 6: Select rotational speed tracking restart or start the motor after it stops. 7: Remove the added load. 8: Select an AC drive of higher power class.
		1: The deceleration time is too short 2: The output of the inverter is grounded or short-circuited 3: There is no parameter identification for the motor in the vector control mode 4: There is a sudden load during deceleration 5: The manual torque rise is too large or the V/F curve is not set properly 6: Low voltage	1. Increase the deceleration time 2. Check the insulation of the motor and cables. 3. Parameter identification of the motor 4. Check the load 5. Reduce the torque boost value or modify the V/F curve value 6. Check the power supply voltage or check the bus voltage value

E003	Constant speed overcurrent	1. The output of the inverter is grounded or short-circuited 2. There is no parameter identification for the motor in the vector control mode 3. There is a sudden load during operation 4. Low voltage 5. Inverter selection is too small	1. Check the insulation of the motor and cables. 2. Parameter identification of the motor 3. Check the load 4. Check the power supply voltage or check the bus voltage 5. Use a frequency conversion with a larger power level device
E004	Accelerating overvoltage	1. The input voltage is too high 2. The acceleration time is too short 3. During the acceleration process, there is an external force that drives the motor to run 4. The braking unit and braking resistor are not installed.	1. Adjust the voltage to the normal range 2. Increase the acceleration time 3. Check the load 4. Install braking unit and braking resistor
E005	deceleration overvoltage	1: The input voltage is too high. 2: An external force drives the motor during acceleration. 3: The acceleration time is too short. 4: The braking unit and braking resistor are not installed.	1: Adjust the voltage to normal range. 2: Cancel the external force or install a braking resistor. 3: Increase the acceleration time. 4: Install the braking unit and braking resistor.
E006	Constant speed overvoltage	1. The input voltage is too high 2. During the operation, there is an external force that drives the motor to run	1. Adjust the voltage to the normal voltage 2. Adjust the load or install braking unit and braking resistor
E007	control power failure	1. Input voltage not within specification 2. The relay does not suck	1. Adjust the voltage to within the normal range
E008	Undervoltage fault	1. The input voltage is low or the contacts are in poor contact 2. The bus voltage is abnormal 3. The relay or contactor does not pull in 4. The control board is abnormal	1: Reset the fault. 2: Adjust the voltage to normal range. 3: Contact the agen.
E010	input phase loss	1. Phase loss of three-phase input power 2. The driver board is abnormal	1: Eliminate external faults
E011	output phase loss	1. The lead wire from the inverter to the motor is abnormal 2. The inverter output three-phase unbalanced or lack of phase 3. The driver board is abnormal 4. Module exception	1: Eliminate external faults. 2: Check whether the motor three-phase winding is normal.
E012	Short circuit to ground	The motor is short circuited to the ground.	Replace the cable or motor.
E014	AC drive overload	1: The load is too heavy or locked-rotor occurs on the motor. 2: The AC drive model is of too small power class.	1: Reduce the load and check the motor and mechanical condition. 2: Select an AC drive of higher power class.
E015	Motor overload	1: PC.01 is set improperly. 2: The load is too heavy or locked-rotor occurs on the motor. 3: The AC drive model is of too small power class.	1: Set PC.01 correctly. 2: Reduce the load and check the motor and the mechanical condition. 3: Select an AC drive of higher power class.
E016	Module overheat	1. The ambient temperature is too high 2. The air duct is blocked 3. The fan is damaged 4. Module overheating device damage	1. Improve the ambient temperature 2. Clean the air duct 3. Replace the fan 4. Seek technical support
E018	External device failure	Input external fault signal through multi-function digital terminal X	reset operation
E021	Current detection failure	1. Current Hall detection damage 2. Drive board failure	1: Replace the faulty current sensor. 2: Replace the faulty drive board.
E026	Motor identification fault	1. Improper setting of motor parameters 2. The parameter identification time is too long	1. Reset the motor parameters 2. Check whether the inverter is connected to the motor
E028	Fast current limit fault	1. Excessive load or motor stall 2. Inverter selection is too small 3. The motor is not self-learning	1. Check the motor and load 2. Self-identification of motor parameters 3. Change the control mode to V/F (PO.00=1) and restart. or right The motor performs rotation self-learning.